

ACOUSTIC RESEARCH LAB.

SPECIAL TEST REPORT ÖZEL DENEY RAPORU




Company Name : EA Mimarlık İnşaat Teknolojileri San. Tic. Ltd. Şti.
Firma Unvanı

Company Address : Yenikale Mahallesi Mustafa Kemal Sahil Bulvarı
Firma Adresi No:33/2 Narlıdere İZMİR

Sample Description : 2 mm Perforated Panetti Standard between
Numunenin Tanımı 12.5 mm Plasterboards + C75 Profile(on elastic bands) + 20 mm Panetti HB + 20 mm Coat + 18 cm Brick Wall + 20 mm Coat + 20 mm Panetti HB + C75 Profile(on elastic bands) + 2 mm Perforated Panetti Standard between 12.5 mm Plasterboards

Certificate No: 201018
Sertifika No


Date: 13/11/2020
Tarih

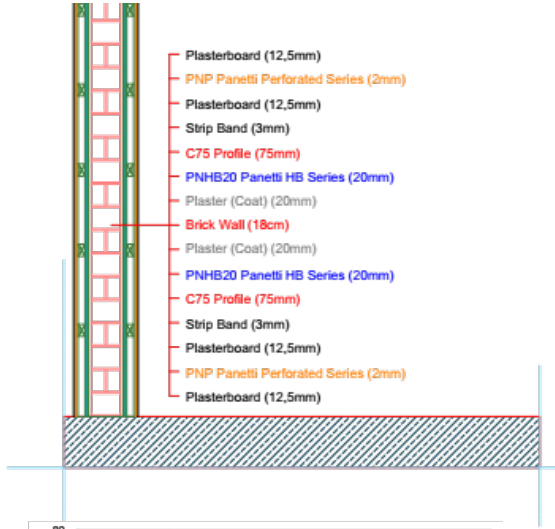

Applied Standard : EN ISO 16283-1
Uygulanan standard

Related Test Report : BLX-R-AI-26
DeneY Raporu

Summary Explanation : R'w is 65 dB.
Özet Açıklama

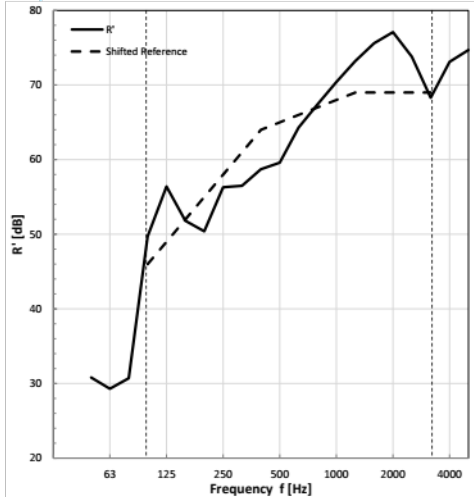

Result (Sonuç)

Sound Reduction Index $R'_w(c, c_{tr})$ dB : 65(-1; -4) dB
Ses Azaltım İndeksi $R'_w(c, c_{tr})$ dB



This document has been issued upon request based on the report referred above and is valid only for the sample tested. This document is a summary of the cited report. The measurement results are valid only for the conditions specified in the main report. Independent of the main report, its distribution is not the responsibility of the BLX Acoustic Research Laboratory. This certificate does not qualify as any "Product Certificate" or "Certificate of Conformity".

Bu belge istek üzerine yukarıda atıf yapılan rapora istinaden düzenlenmiş olup sadece deneyi yapılan numune için geçerlidir. Bu belge atıf yapılan raporun özeti niteliğindedir. Ölçüm sonuçları sadece ana raporda belirtilen koşullar için geçerlidir. Ana rapordan bağımsız olarak dağıtımı BLX Akustik Araştırma Laboratuvarı sorumluluğunda değildir. Bu sertifika herhangi bir "Ürün Belgesi" veya "Uygunluk Belgesi" niteliğinde değildir.

BLX-FR-88 Revision No/Tarihi:00/--
İlk Yayın Tarihi: 12.10.2020
Prepared by: Quality Manager
Approver: General Manager

